

THIS DOCUMENT AND ATTACHMENT(S) ARE AVAILABLE FOR DOWNLOAD AT
http://www.bxwa.com/bxwa_toc/pub/1687/toc.html
AN EMAIL NOTIFICATION WAS SENT TO REGISTERED PLANHOLDERS. FAILURE TO
ACKNOWLEDGE RECEIPT ON THE BID FORM DOES NOT AFFECT THE BIDDER'S
OBLIGATION FOR COMPLIANCE.



ADDENDUM NO. 1

WASHINGTON STATE PARKS AND RECREATION COMMISSION
SUN LAKES STATE PARK
SEWER LIFT STATION REPLACEMENT
EW-C6702

DATE: OCTOBER 10, 2024

ATTENTION TO PLANHOLDERS OF RECORD. The following revisions are hereby made a part of the Contract Documents. Please be sure to acknowledge all Addenda on the Bid Form.

PROJECT MANUAL

I. SPECIFICATIONS

SECTION 323113 – CHAINLINK FENCE

PART 2 – PRODUCTS

2.1 MATERIALS

REPLACE section “D” with the following:

D. Steel Fence Framework: Steel pipe - Type I: ASTM F1043 Group IC; minimum yield strength of 50,000 psi. Outside diameter (OD) sizes as shown on the Plans. Type B external coating, hot dip galvanized zinc 0.9 oz/ ft² with a clear polymeric overcoat, Type D interior 90% zinc-rich coating having a minimum thickness of 0.30 mils.

II. PLAN SHEETS

REPLACE plan sheet 12 with the attached page. Note number 5 was added to detail LS09 stating the fence height as 6-feet.

Attachments:

- Addendum Acknowledgement (1 page)
- Addendum Drawing (1 page)

Brett Taylor


Brett Taylor, Contracts Specialist 2
Contracts and Grants Program


10/08/24

Date

END OF ADDENDUM NO. 1

Addendum No. 1 is hereby made a part of these contract documents, and its terms and conditions are fully binding on the planholder and contractor. The contractor shall acknowledge receipt of this Addendum No. 1 by signing in the space provided below and attaching it to his proposal.


<p>RH2 ENGINEERING, INC. <u>Paul Young, P.E.</u> Issued <u>October 4, 2024</u></p> 	<p>Received and acknowledged:</p> <hr/> <p>Contractor</p> <hr/> <p>By</p> <hr/> <p>Title</p> <hr/> <p>Date</p>
---	--

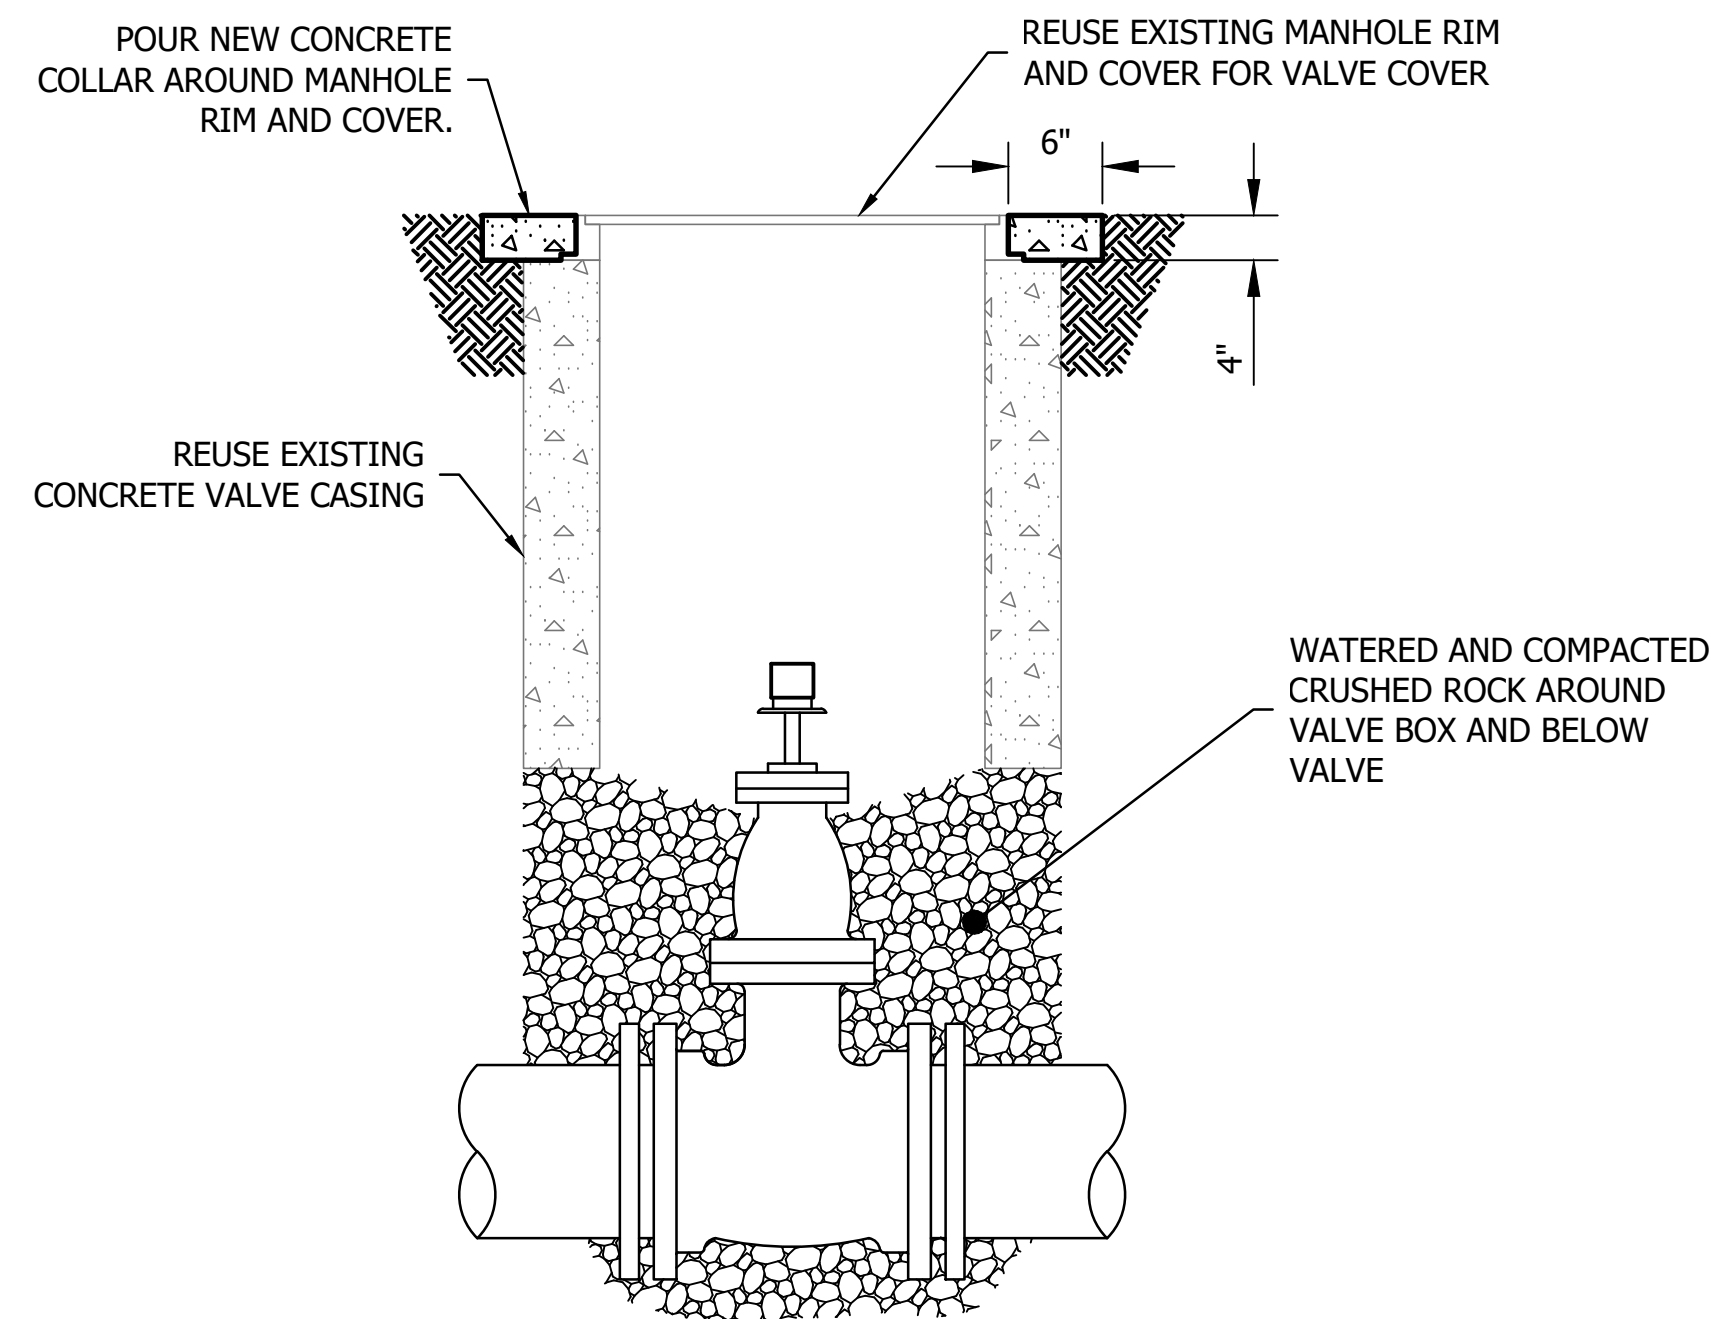

1. ISOLATION VALVES 2" AND LARGER ARE TO BE NRS RESILIENT SEAT GATE VALVES MEETING AWWA C509 OR C515.
2. BACKFILL AROUND VALVE CASING SHALL BE COMPACTED USING A JUMPING JACK.

ISOLATION VALVE INSTALLATION DETAIL


NOT TO SCALE

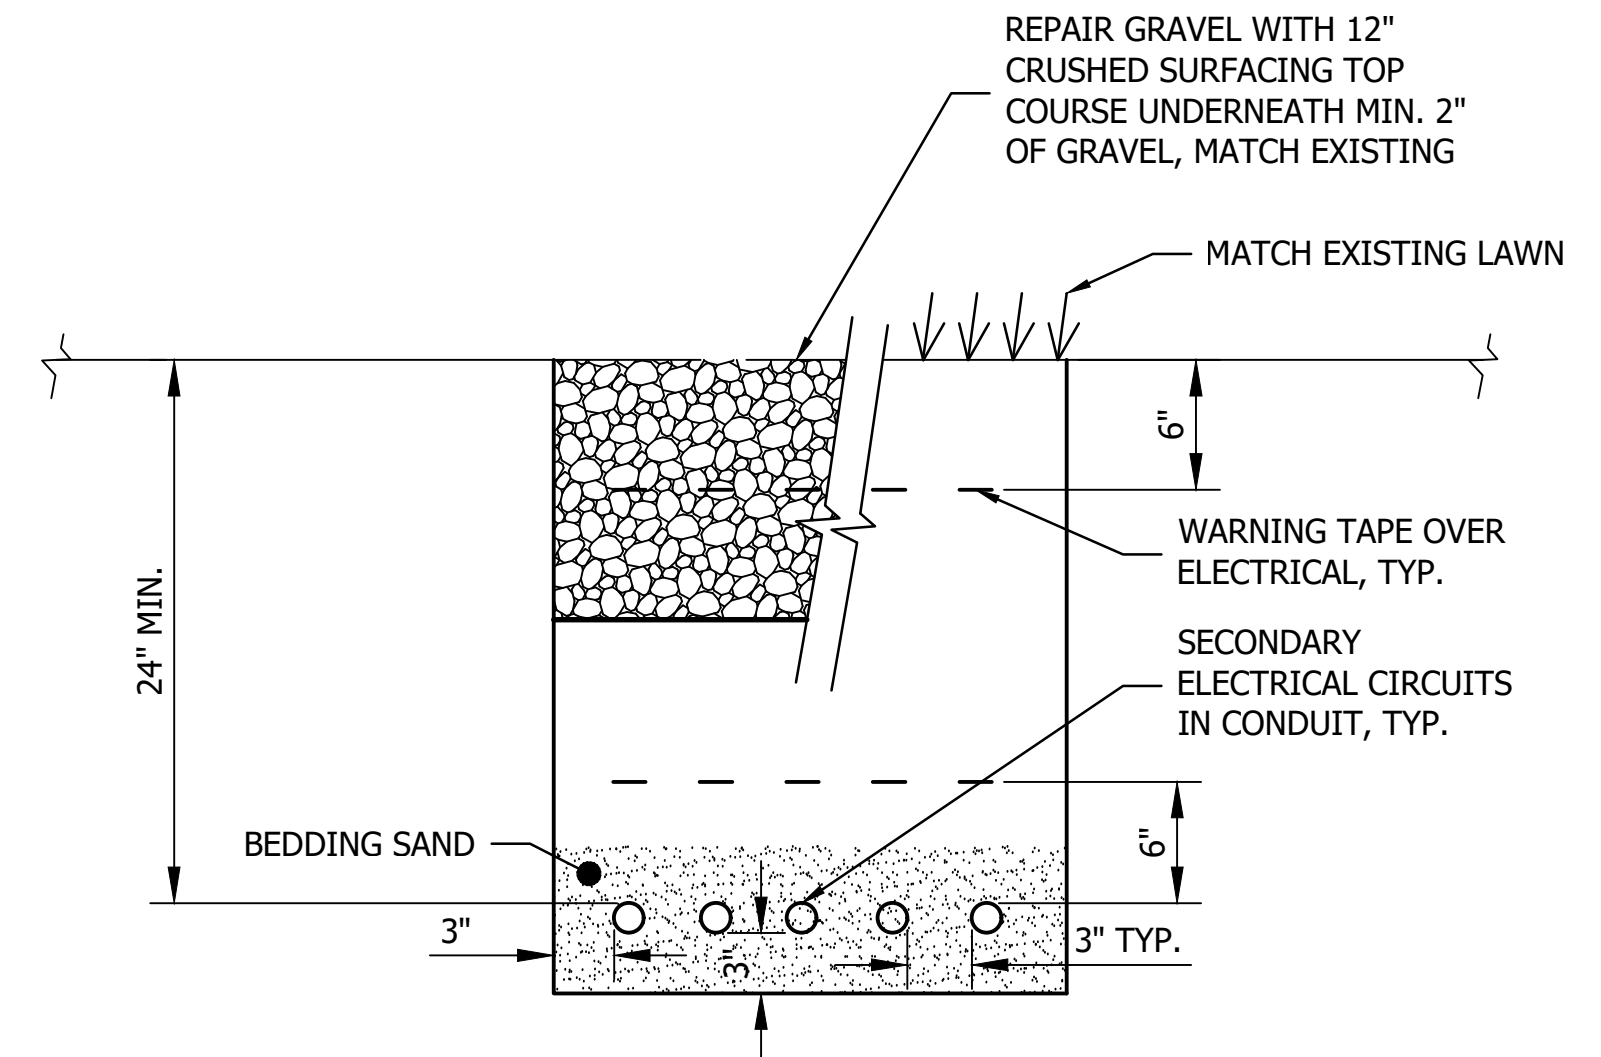

1. WHEN MULTIPLE UTILITIES ARE IN THE SAME TRENCH, THERE SHALL BE 3" SEPARATION BETWEEN LIKE UTILITIES AND 18" BETWEEN DIFFERENT UTILITIES.
2. NO UTILITIES SHALL BE PLACED OVER UNDERGROUND ELECTRICAL.
3. REPAIR LAWN, SEE SPECS.

ELECTRICAL TRENCH DETAIL

NOT TO SCALE


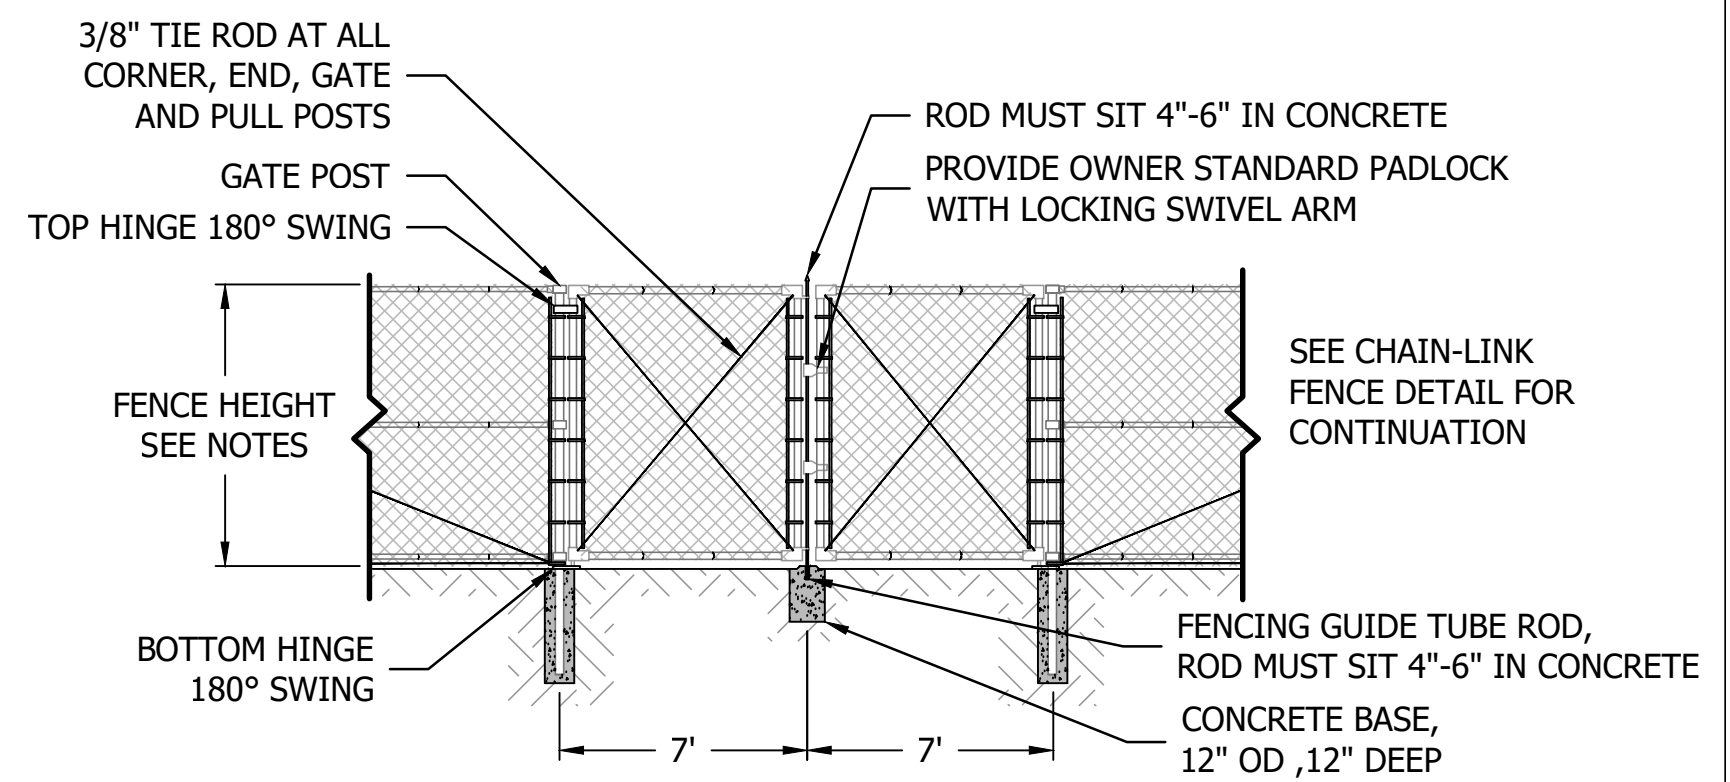


DOUBLE SWING GATE

NOT TO SCALE




NOTE: TOP SLAB NOT SHOWN THIS VIEW FOR CLARITY.

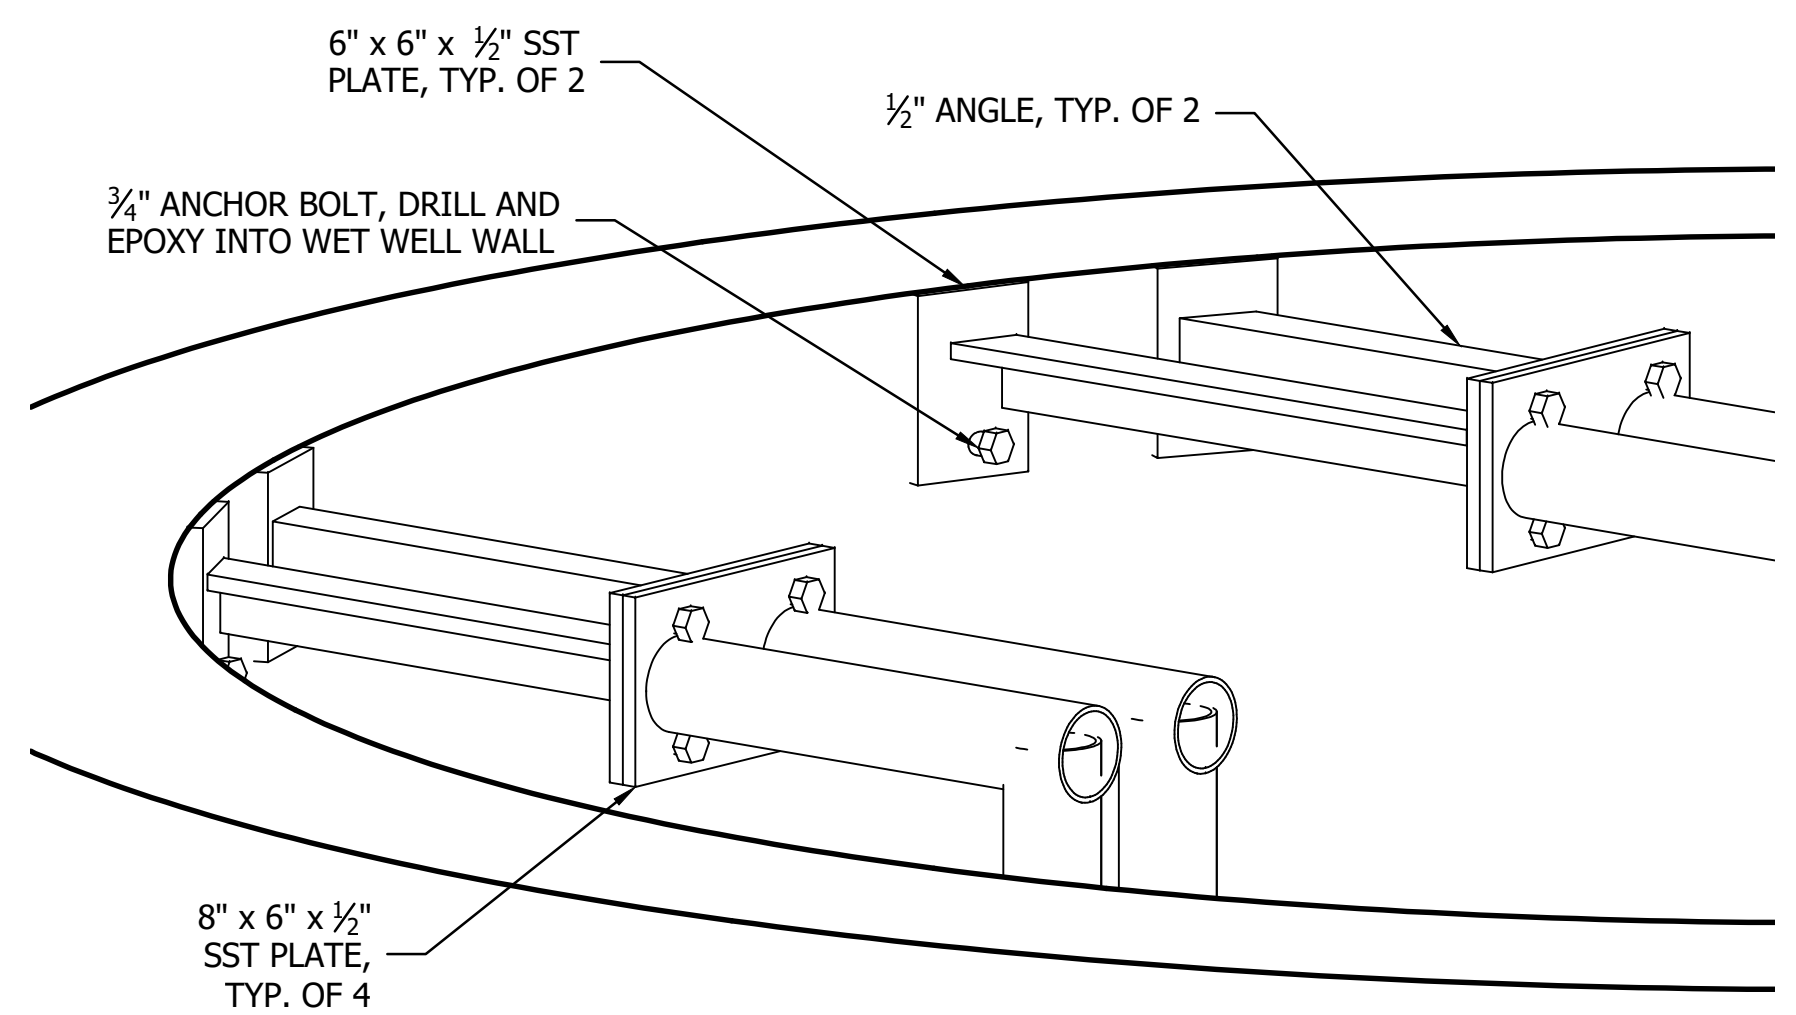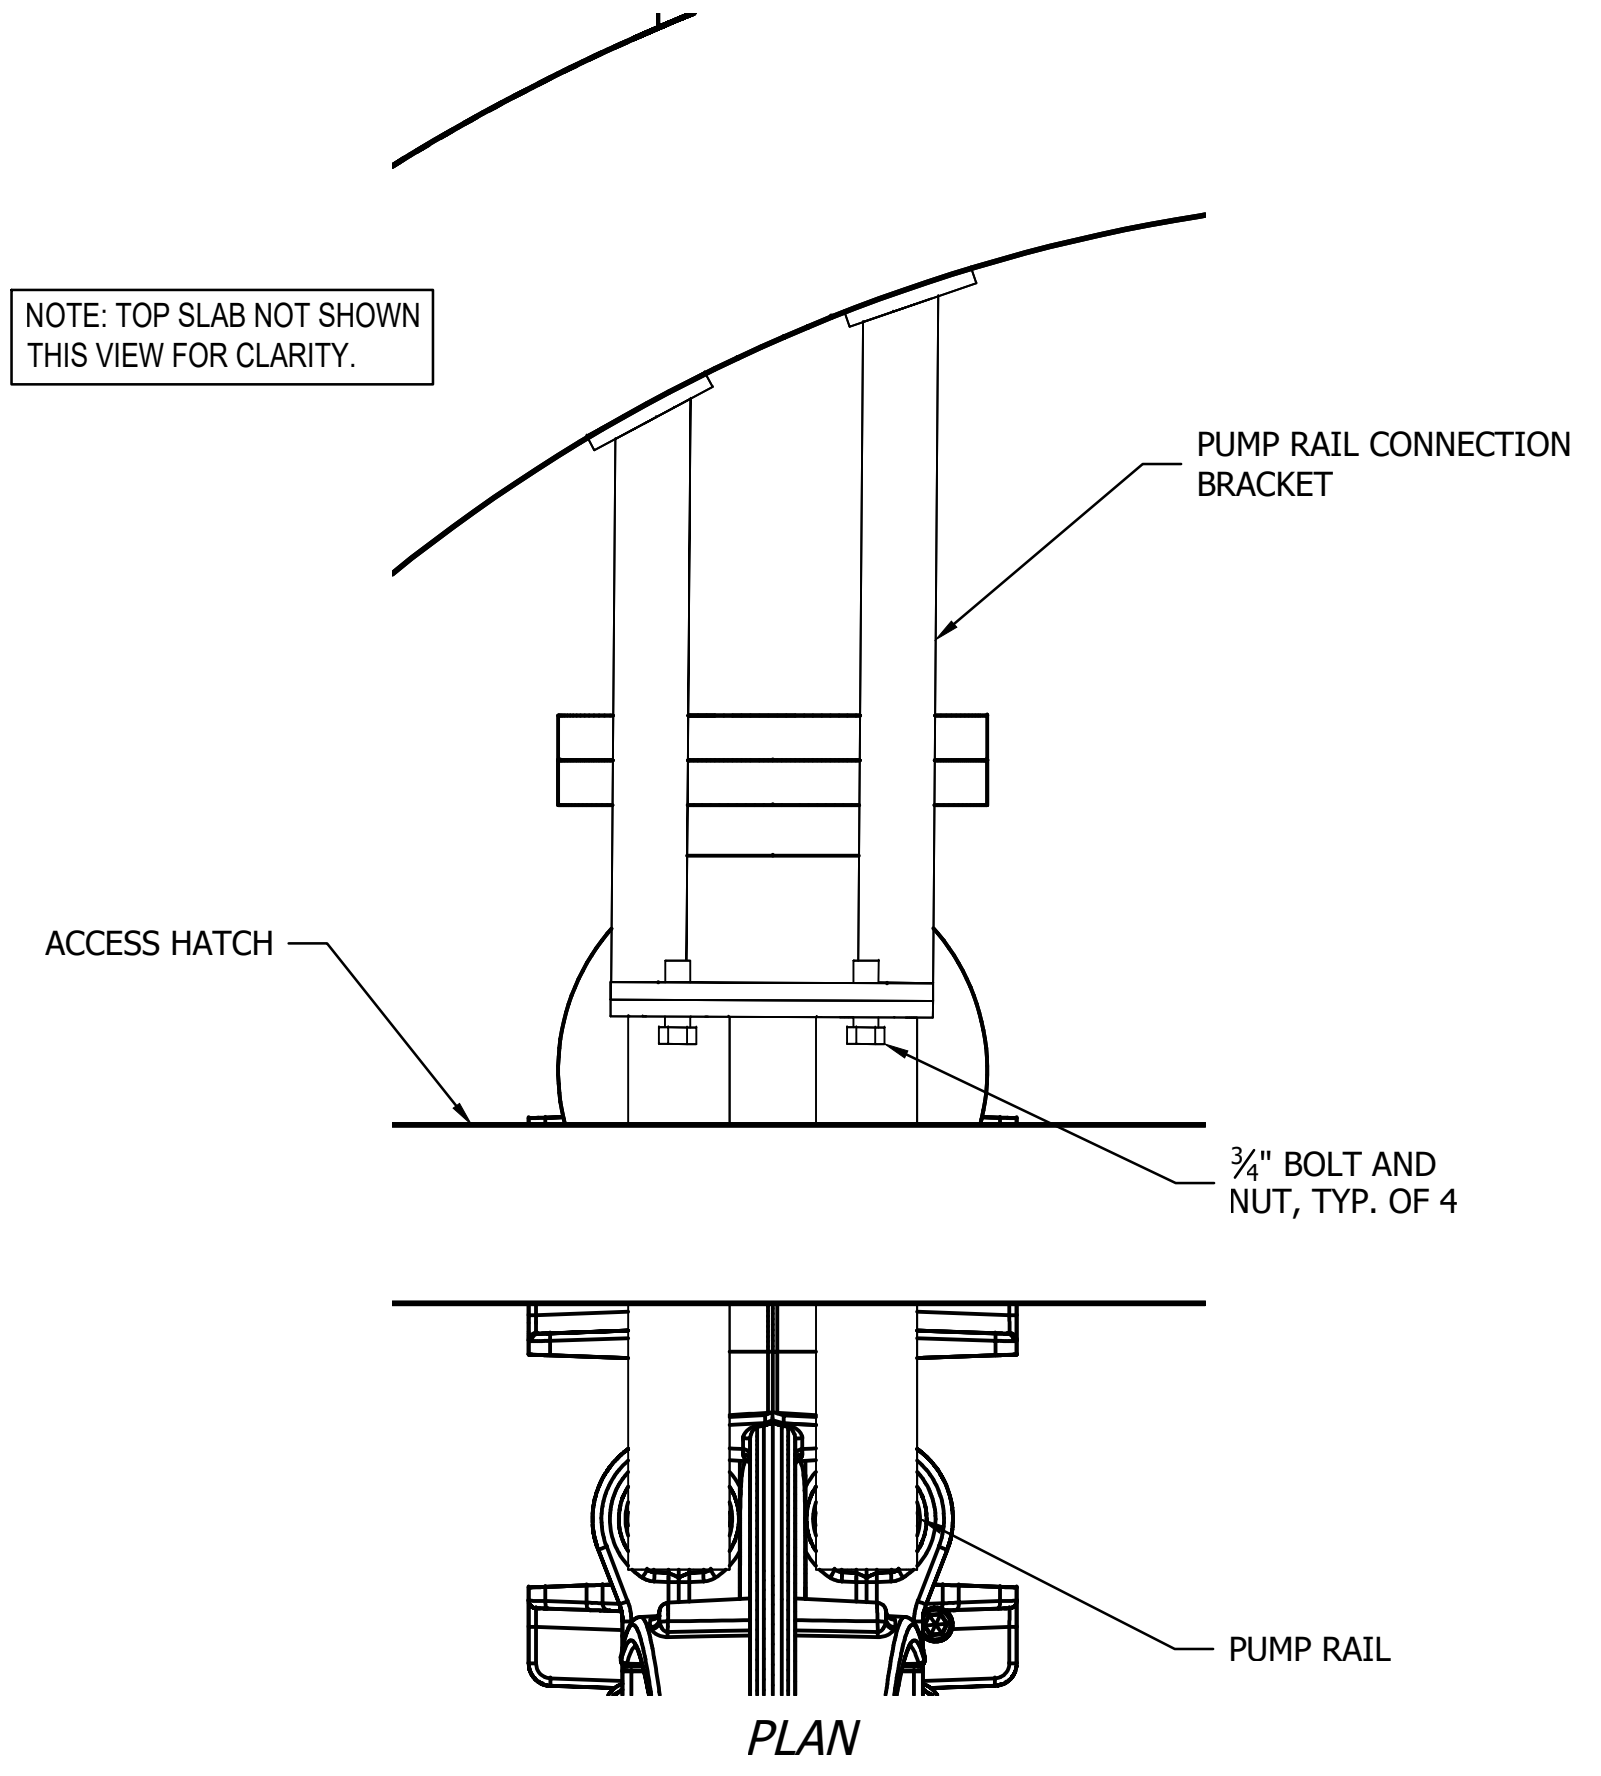

OBLIQUE

PUMP RAIL CONNECTION DETAIL

NOT TO SCALE

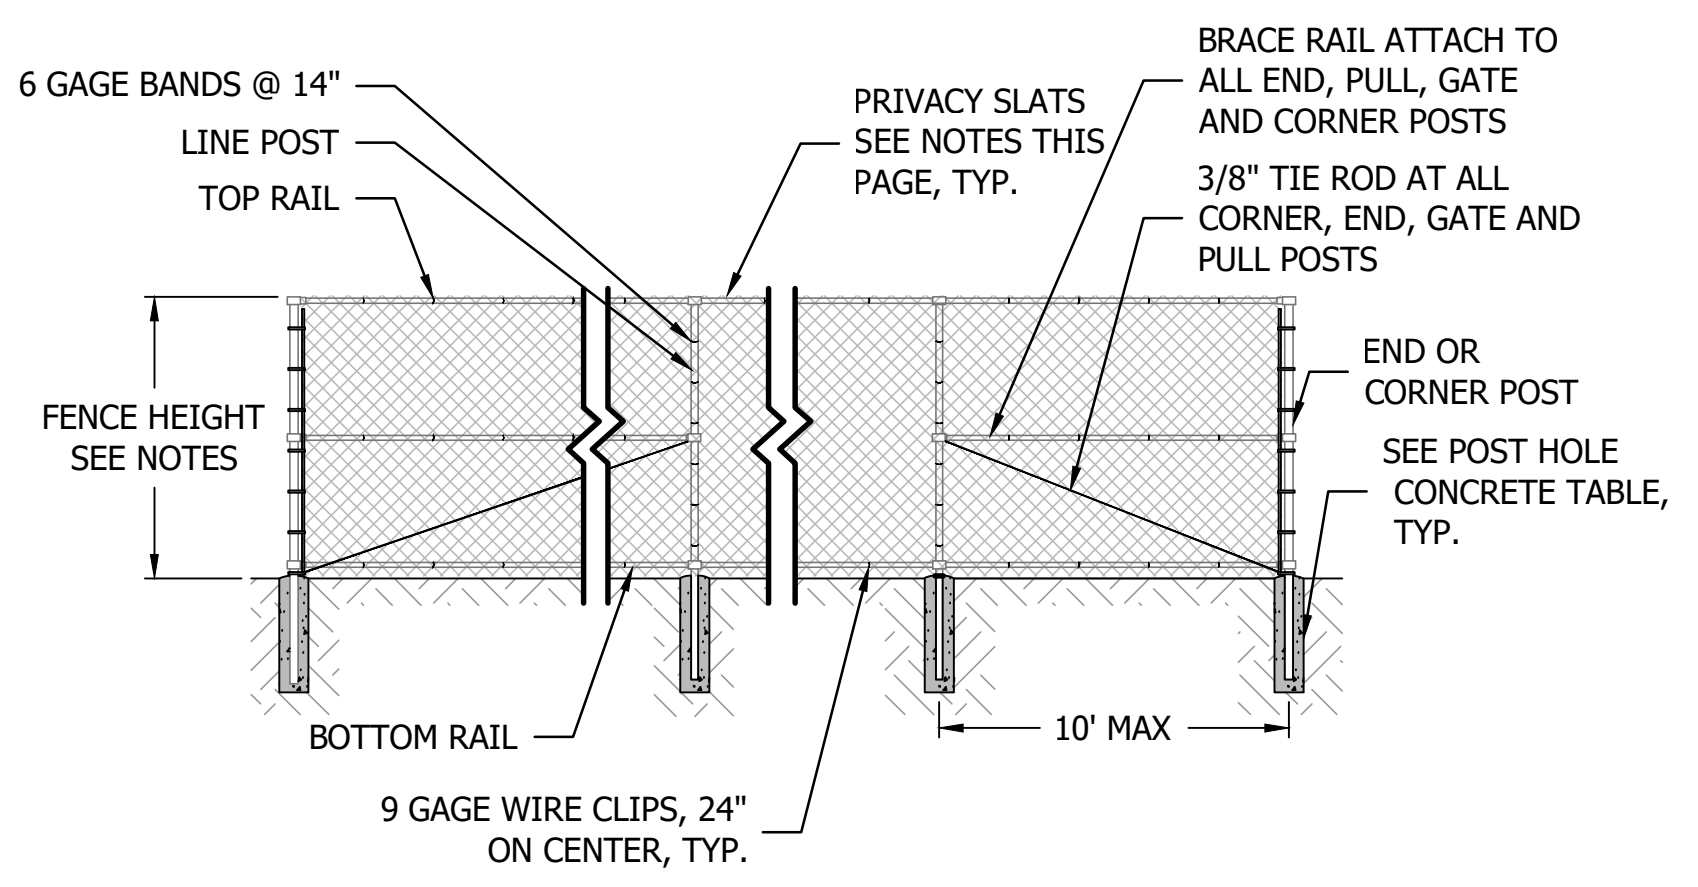

CHAIN-LINK FENCE

NOT TO SCALE



POST HOLE CONCRETE*		
	GATE AND END POST	LINE POSTS
MIN. DEPTH	60"	60"
MIN. DIAMETER	24"	24"
MIN. POST EMBEDMENT	54"	54"

*FOOTINGS SIZED TO RESTRAIN PRIVACY SLAT FENCE

POST AND RAIL SCHEDULE		
END, PULL, GATE, CORNER POSTS	LINE POSTS	TOP, MID AND BOTTOM RAIL
4" OD	2.875" OD	1.66" OD

- NOTES:
1. NOTE: MINIMUM DEPTHS BASED ON IBC GRAVEL(GW) OR SANDY GRAVEL(GP) SOIL TYPES PER IBC TABLE 1804.2.
 2. CONCRETE FOR ALL FOOTINGS SHALL BE 4000 PSI CONCRETE.
 3. ALL CHAIN LINK FENCE SHALL BE VINYL COATED.
 4. PROVIDE VERTICAL PRIVACY SLATS WITH VERTICAL LOCKING FEATURE, NEUTRAL COLOR.
 5. FENCE HEIGHT TO BE 6'.

CAD NO. slls-p-lsdet

NO.	REVISIONS	INT.	APP.	DATE
1	REVISED PER ADDENDUM NO. 1	PNY	RCP	10/04/24

ACTION	BY	DATE
DESIGNED	PNY	6/27/2024
DRAWN	JTR	6/27/2024
CHECKED (FIELD)		
CHECKED (HDQTS.)		



SIGNED: 06/27/2024
PROJECT ENGINEER

WASHINGTON STATE PARKS AND RECREATION COMMISSION



SUN LAKES STATE PARK

SEWER LIFT STATION REPLACEMENT

LIFT STATION DETAILS 2

